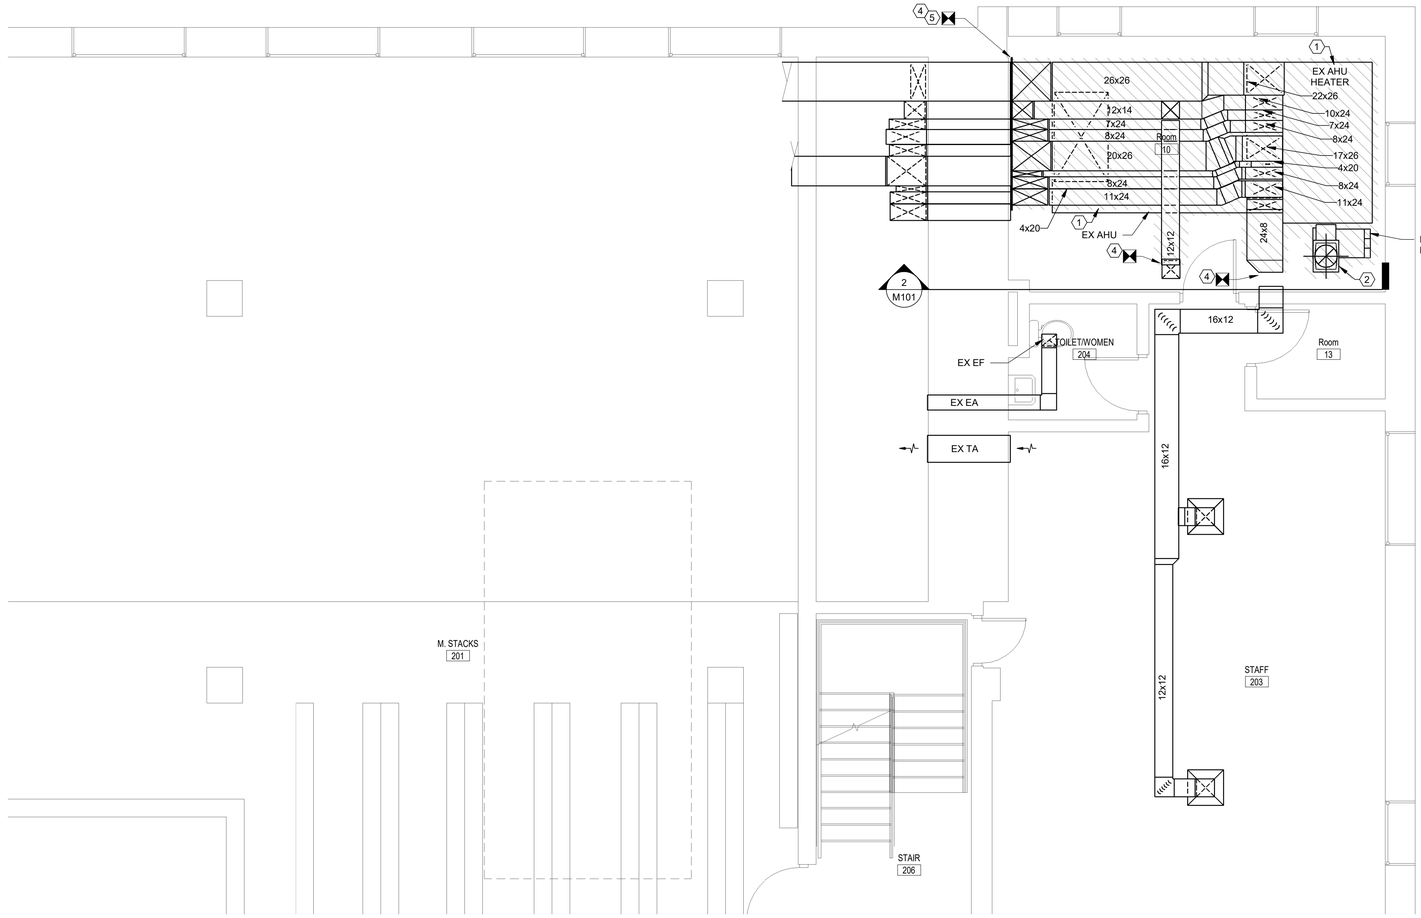

1 SECOND FLOOR PLAN - MECHANICAL DEMOLITION
SCALE: 1/4" = 1'-0"

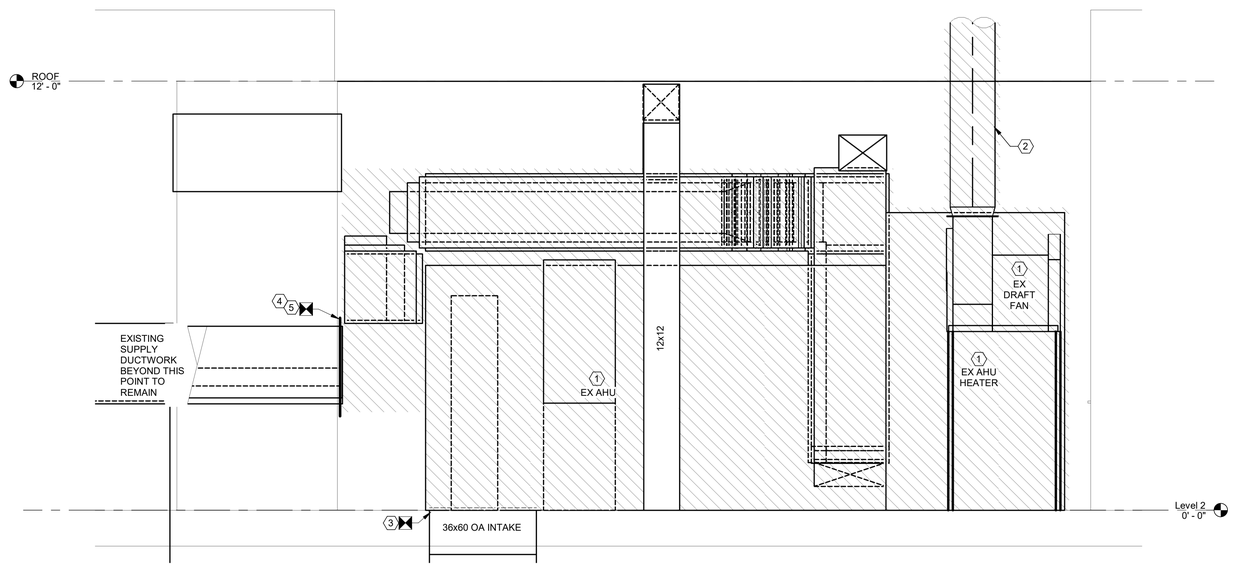

2 MECHANICAL DEMOLITION - MECHANICAL ROOM SECTION
SCALE: 1/2" = 1'-0"

MECHANICAL KEYNOTES

1	DEMOLISH EXISTING AHU INCLUDING ALL ACCESSORIES AND CONTROLS IN THEIR ENTIRETY.
2	DEMOLISH EXISTING STACK AND PATCH EXISTING ROOF PENETRATION TO MATCH ROOF.
3	DISCONNECT EXISTING OA INTAKE MECHANICAL ROOM FLOOR.
4	PRIOR TO DEMOLITION BALANCER SHALL MEASURE AND RECORD ZONE AIRFLOW AT 100% FAN SPEED. (TYPICAL OF ALL ZONES)
5	DISCONNECT ALL EXISTING ZONE SUPPLY DUCTWORK AT MECHANICAL ROOM WALL. ALLOW ENOUGH LENGTH OF DUCT TO CONNECT TO NEW DUCTWORK. MAINTAIN EXISTING FIRE DAMPER ASSEMBLIES. CONTRACTOR SHALL REPORT ANY DEFICIENCIES WITH EXISTING FIRE DAMPERS. INCLUDE BID FOR REPLACEMENT OF A MINIMUM OF (5) EXISTING FIRE DAMPERS DUE TO AGE OF THE SYSTEM.

H.F. LENZ COMPANY
ENGINEERING
1407 Scalp Avenue
Johnstown, PA 15904-3329
Phone: 814-269-9300
FAX: 814-269-9301
www.hflenz.com

Seal:

Seal:



12-23-22

Project Identification:

COSHOCTON PUBLIC LIBRARY
655 MAIN STREET
COSHOCTON, OHIO 43812

BID DOCUMENTS

ISSUES

REVISIONS

Sheet Title:
SECOND FLOOR MECHANICAL DEMOLITION PLAN

Project Number:	2022-0204.01
Drawn By:	BSH
Checked By:	LES
Date:	12/23/22
Copyright:	© 2022 H. F. LENZ COMPANY
Drawing Number	M101